Appendix VII. Water Treatment Plant and Effluent Pipeline Drawing

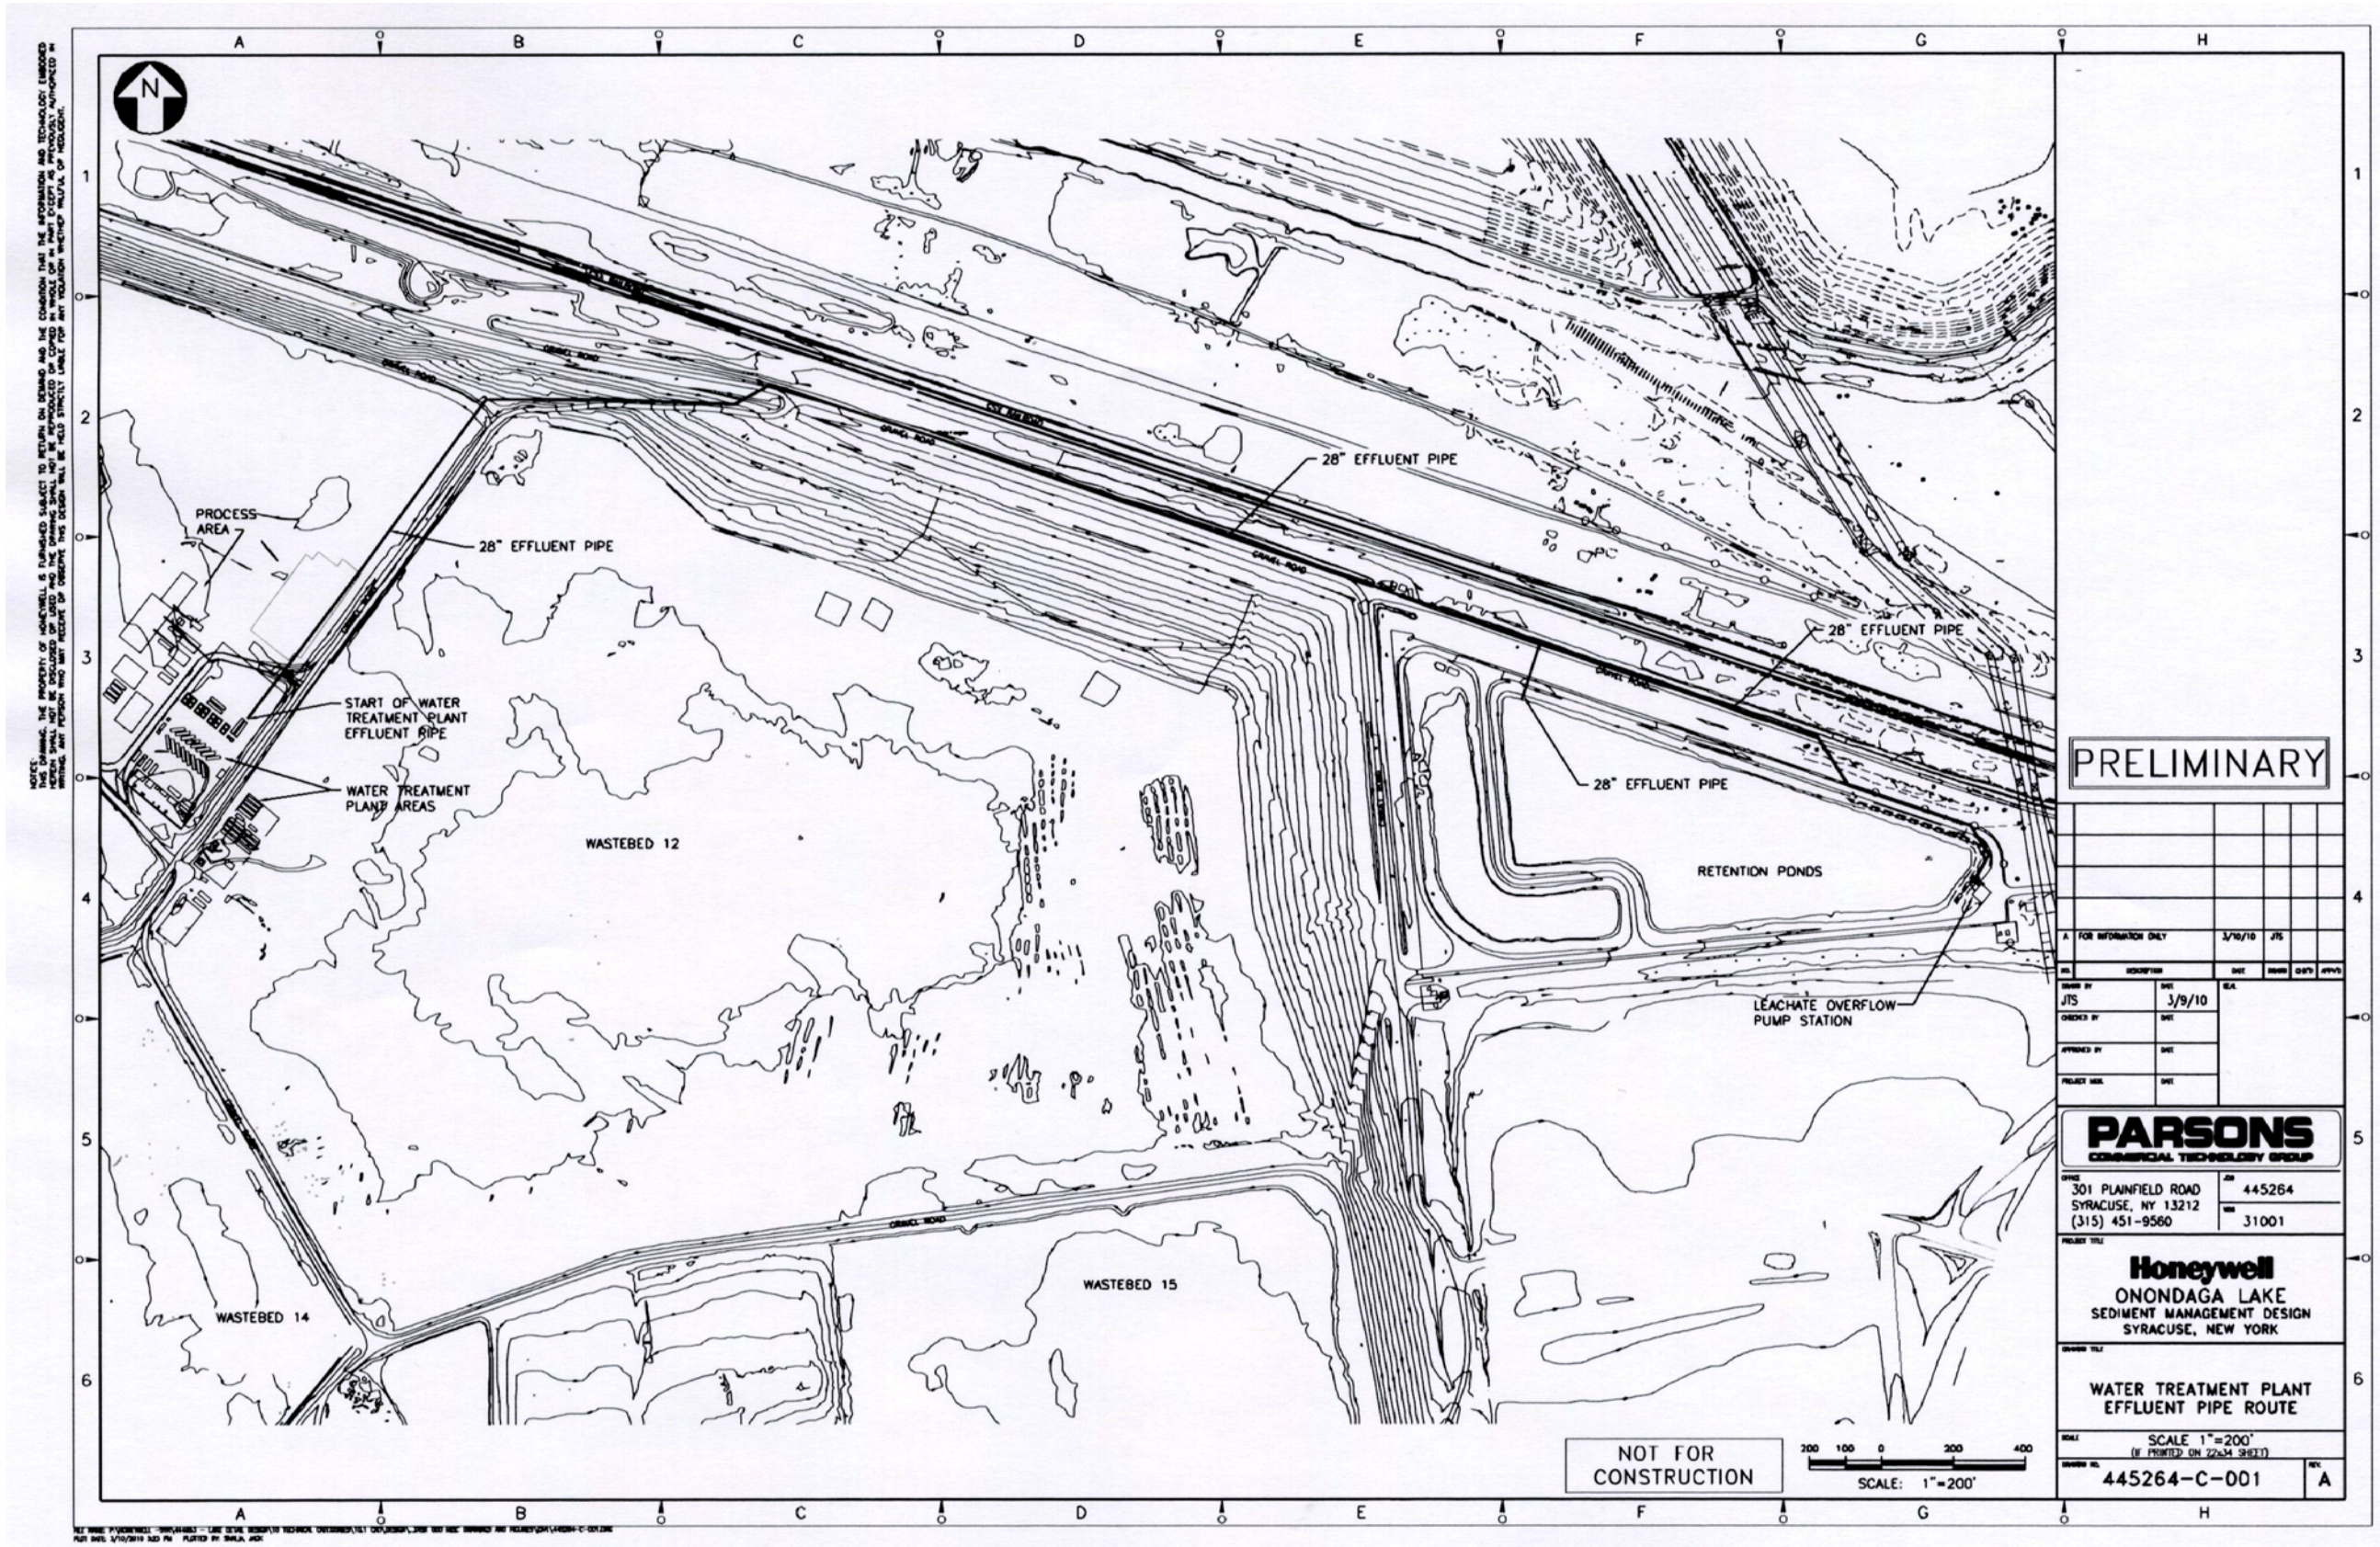
PROCESS AREA
28" EFFLUENT PIPE
START OF WATER TREATMENT PLANT EFFLUENT PIPE
WATER TREATMENT PLANT AREAS
WASTEBED 12
WASTEBED 14
WASTEBED 15
RETENTION PONDS
LEACHATE OVERFLOW PUMP STATION
NOT FOR CONSTRUCTION
SCALE: 1"=200'
PRELIMINARY
A FOR INFORMATION ONLY 3/10/10 JTS
JTS 3/9/10
PARSONS
COMMERCIAL TECHNOLOGY GROUP
301 PLAINFIELD ROAD
SYRACUSE, NY 13212
(315) 451-9560
445264
31001
Honeywell
ONONDAGA LAKE
SEDIMENT MANAGEMENT DESIGN
SYRACUSE, NEW YORK
WATER TREATMENT PLANT
EFFLUENT PIPE ROUTE
SCALE 1"=200'
(IF PRINTED ON 22x34 SHEET)
445264-C-001
A